




Zingonia
 Fan test laboratory
 AMCA 210/99 Fig. 12
 10000 m³/h test chamber

Air Density (γ): 1.20 kg/m³
 Installation type "B": free inlet, ducted outlet
 dB(A) free field noise measurements at 1 m

Type:	DD 9/9	Watt:	550	Amp Max:	5.1
Motor:	1419F5	Volt:	230 1~	Prot.:	IP 44
Test nr.:	3176.*	Hz:	50	T.H.:	YES-OUT
Date:	26/09/2006	Poles:	4	Ins. Cl.:	F
		μ F:	16 / 500 V		

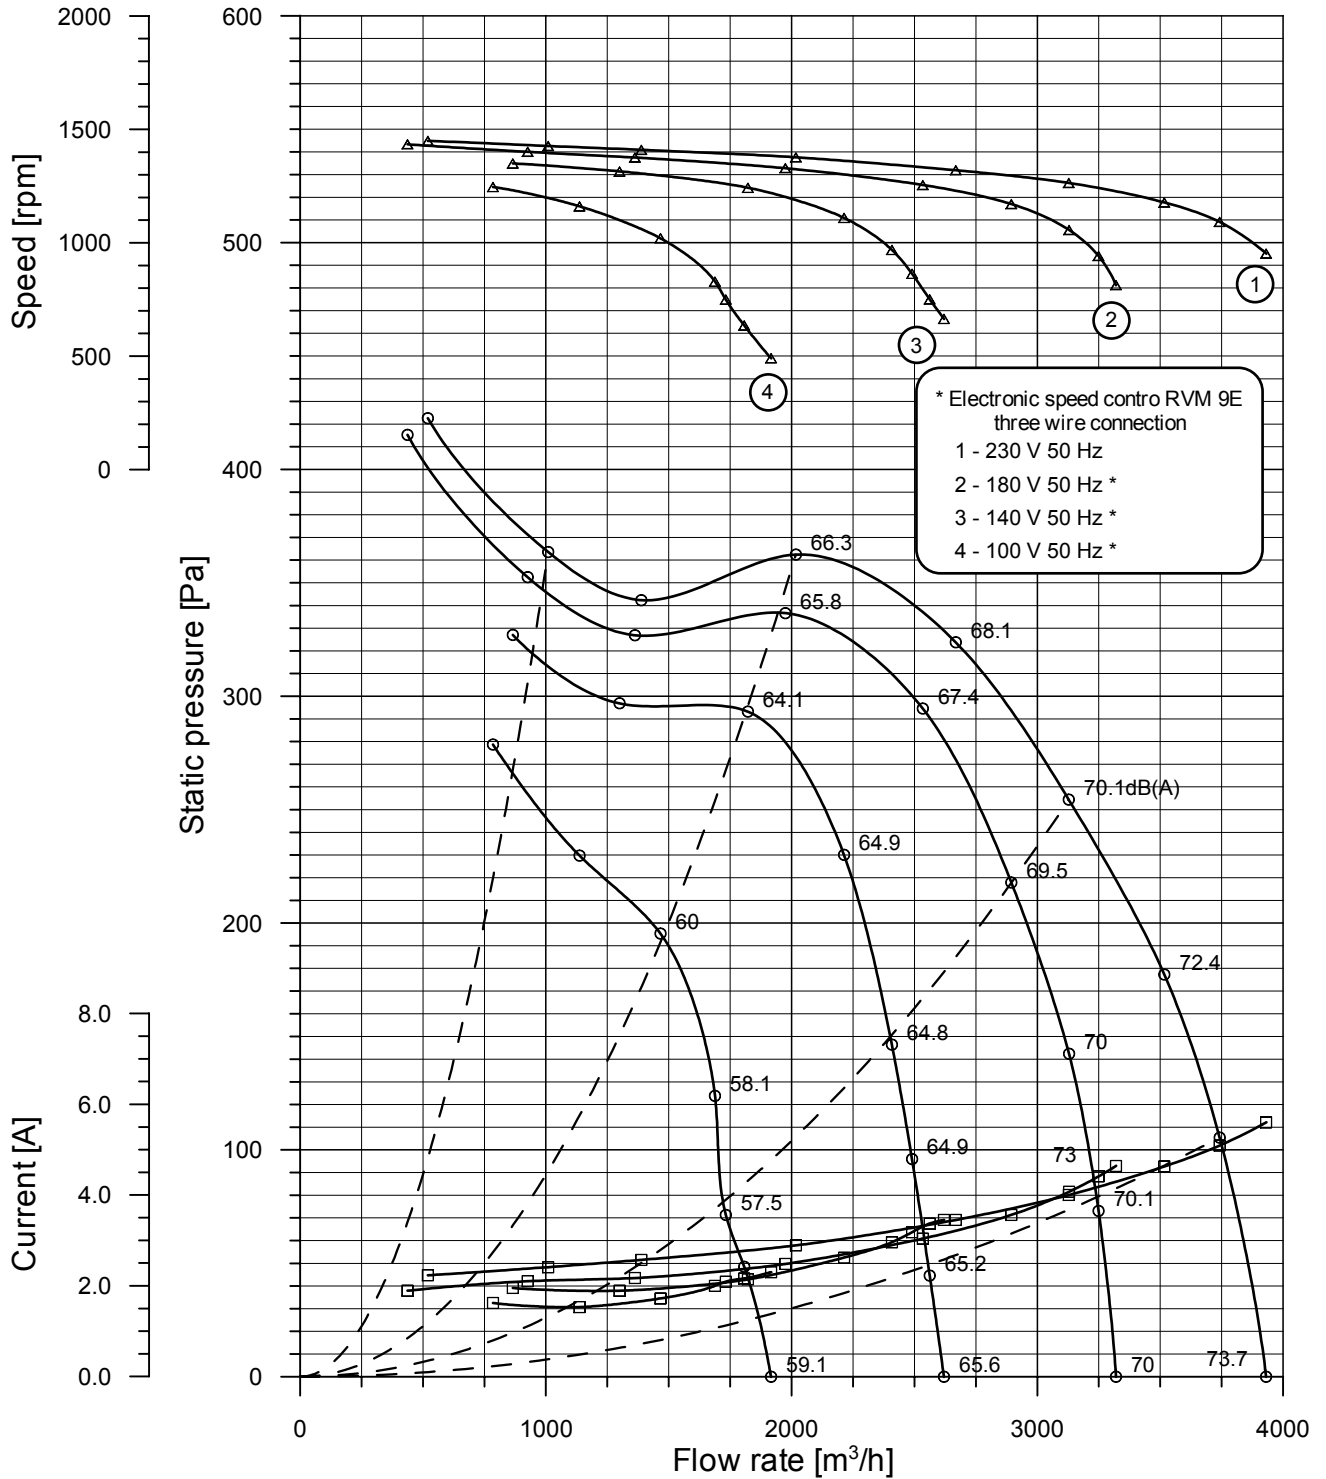

This test data obtained in a laboratory registered by AMCA for AMCA 210/99 air performance testing. Data is not certified by AMCA.